


WR - Pending

Existing Meters 1000789957 and 1000798352

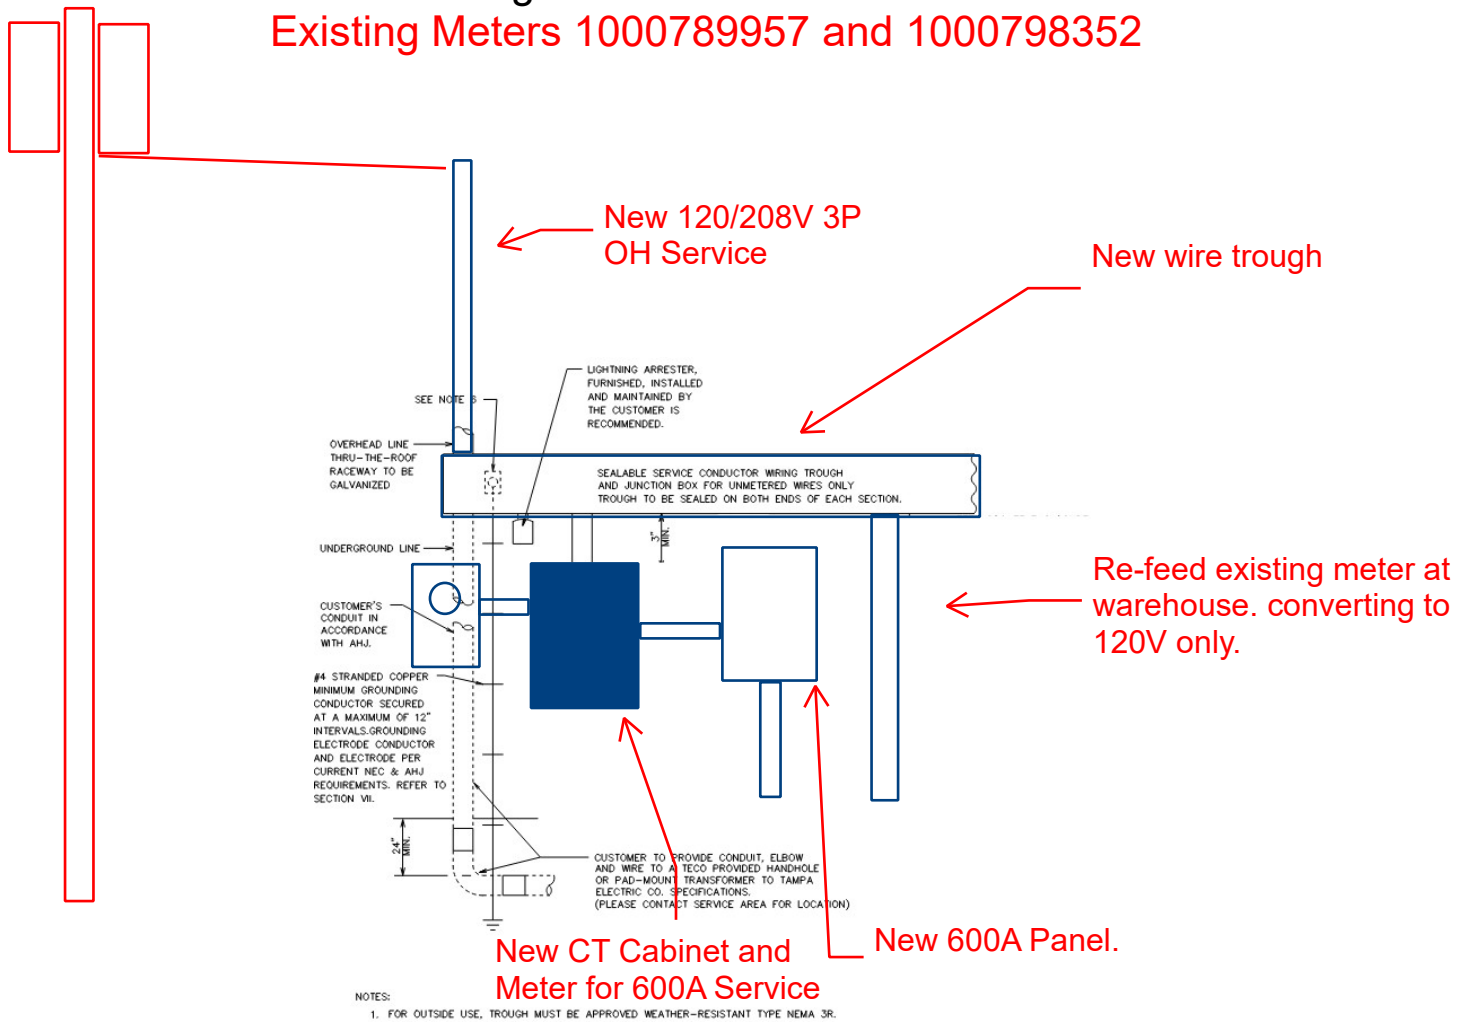


WR - 2618529

Existing Meters 1000771777

Double check there isn't a 2nd meter at this location...

1000807566 (AT&T Mobility LLC)

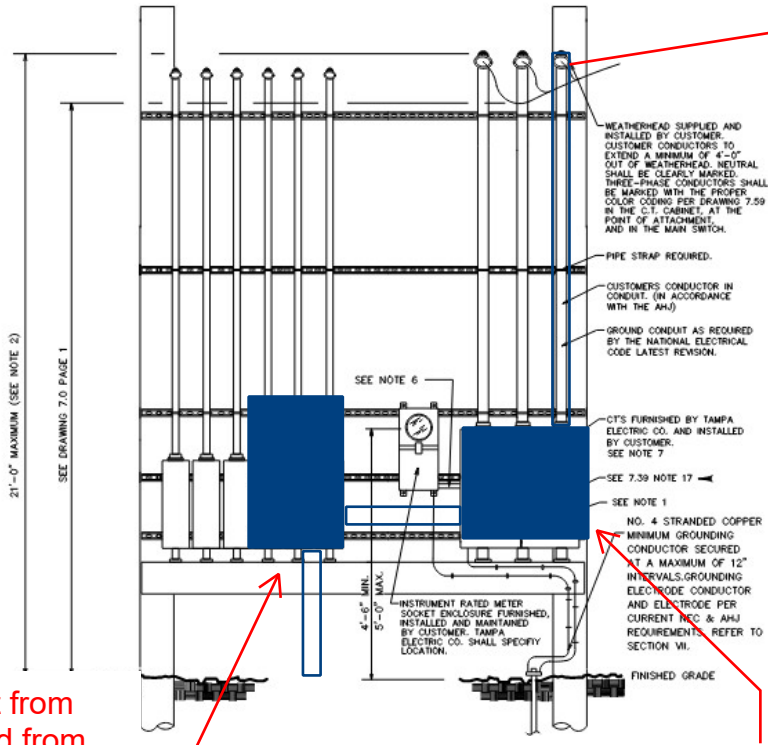

Upgraded 120/208V 3P OH Service

New 600A Disconnect from trough or directly piped from the CT Cabinet. You can arrange this for your needs.

New Rack, CT Cabinet and Meter for 600A Service




WR - 2618530

Existing Meters 1000785011

Double check there isn't a 2nd meter at this location...

1000767340 (FSFA)

Transformer also feeds TECO lighting from the Handhole.

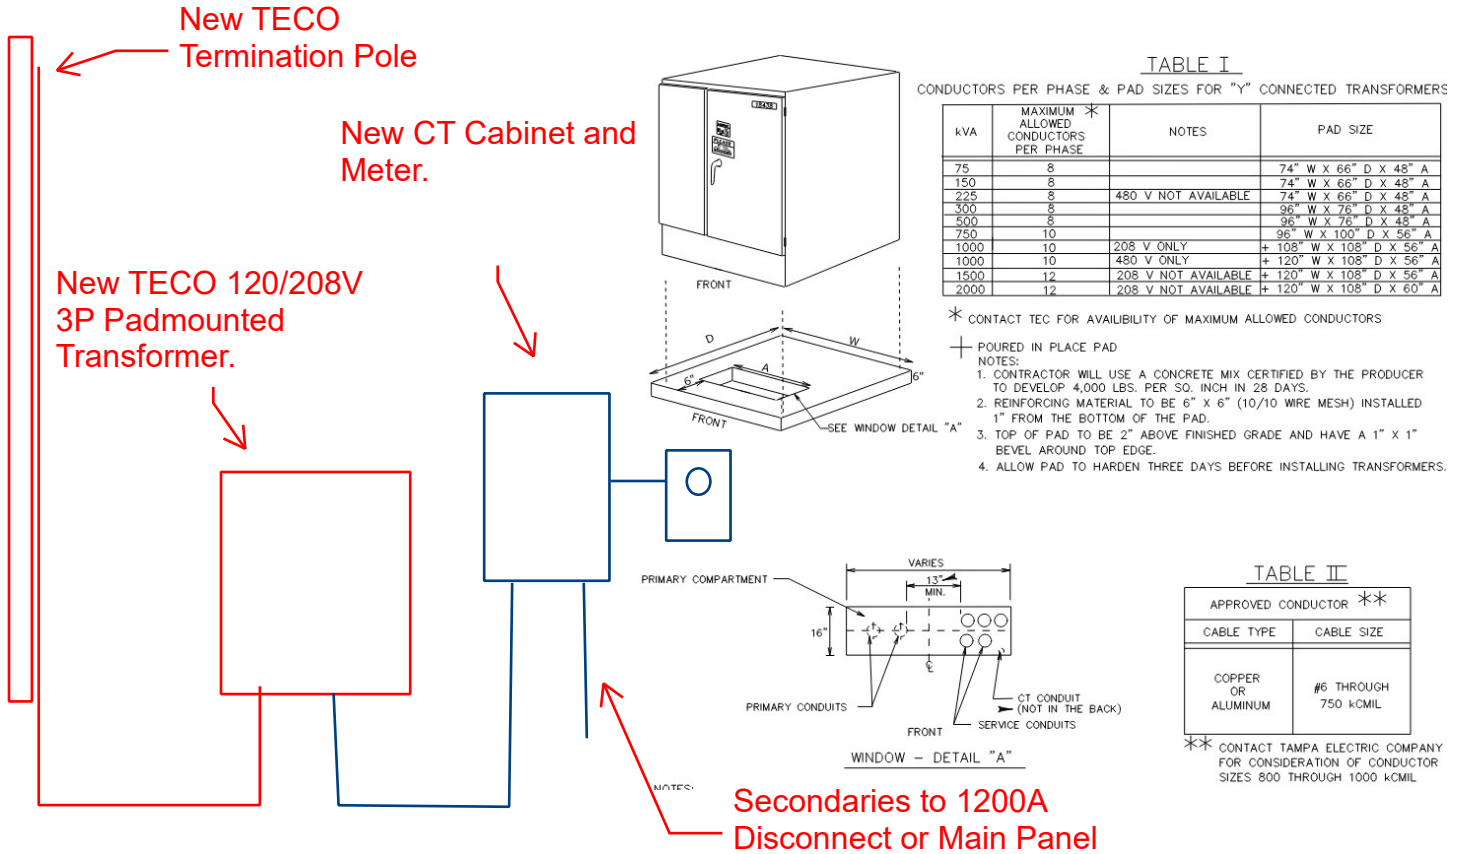

WR - Pending

Existing Meters ... Ned to confirm meter numbers

Upgrade OH bank to 120/240V 3P Delta

Need to install (2) New 400A or Less Meter Cans and service risers at the building. TECO will install new secondary poles at the building to raise the OH secondary lines crossing the asphalt drive.

